

SMS Incident Report


25/07/2017 11:07:58

Summary

CAD Number F2346989 **Status** Closed
Station Papatoetoe Station
Incident Started 20/07/2017 15:25:14 **Incident Ended** 20/07/2017 15:33:58
Incident Type 7104: False alarm: Accidental operation
Common Name LIFE NZ SOUTH MANUKAU
Address 3 LAKEWOOD COURT MANUKAU
Alarm Method Sprinkler PFA Call **Alarm Level** 1
PFA Number 113172
Zone 143403
Map Grid E 1767918 **Map Grid N** 5904049
First Caller **First Caller Contact**
Incident Closed 20/07/2017 15:36:36
Report Completed 19:6, Mon 24 Jul 2017 by Len Opai

Responses

Call Sign	Type	Station Alert	Enroute Time	Arrival Time	Departed
PAPA347	PR	15:25:53 20 Jul 2017	15:27:06 20 Jul 2017	15:30:26 20 Jul 2017	15:34:09 20 Jul 2017
PAPA344	PM	15:25:53 20 Jul 2017	15:27:09 20 Jul 2017	15:31:05 20 Jul 2017	15:31:57 20 Jul 2017

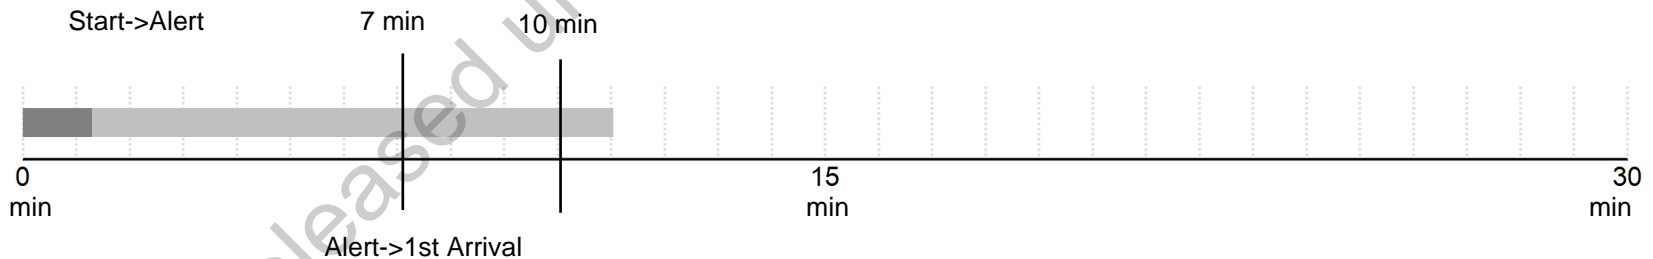

Elapsed Times

Call Sign	Start To Alert	Alert To Arrival	Start To Arrival	Start To Departed
PAPA347	00:00:39	00:04:33	00:05:12	00:08:55
PAPA344	00:00:39	00:05:12	00:05:51	00:06:43

Message Log

Time	Message
15:25:15	AL: 113172 15:25:14 INITIAL - AL
15:25:15	PANEL: FRONT OF BUILDING
15:25:16	** LOI search completed at 20/07/17 15:25:16
15:25:30	ACCESS NO: -C34-117
15:25:41	** Recommended unit PAPA347 for requirement PUMP (>1.6 km)
15:25:41	** Recommended unit PAPA344 for requirement PUMP (>1.6 km)
15:27:06	Unit PAPA347 [K1 : PROCEEDING TO INCIDENT]
15:27:09	Unit PAPA344 [K1 : PROCEEDING TO INCIDENT]
15:30:26	Unit PAPA347 [K77 : NOTHING SHOWING]
15:31:06	Unit PAPA344 [K2 : IN ATTENDANCE AT INCIDENT]
15:31:58	Unit PAPA344 [K4 : ON RT INSIDE NORMAL TURNOUT AREA]
15:33:13	Unit PAPA347 [KC : UNIT CALLING]
15:33:58	Unit PAPA347 [K46-5 : STOP MESSAGE: FALSE ALARM ALARM AGENT IN ATTENDANCE] SO
15:33:58	OPAI -
15:34:11	Unit PAPA347 [K4 : ON RT INSIDE NORMAL TURNOUT AREA]
15:36:36	** Assigned Result Code: SPRNKLR, Detailed Event Type: 7100, Qualifier 1: Q1,
15:36:36	Qualifier 2:

Incident

CAD Number	F2346989
Incident Reporter	Len Opai
Incident Controller	Len Opai
Distance Travelled (km)	3
Delay In Receiving Call	

False Alarm

Detector Type	Sprinkler
False Alarm Cause	Human Intervention Accidental alarm activation by (a) service agent
Other Cause	

Property Details

Occupant	
Building Owner	
General Property Use	Church, Cemetery, Religious use
Special Property Use	Auditorium, Concert hall
Purpose Group	CL - Crowd Large

Released under the Official Information Act