

# SMS Incident Report


26/02/2018 09:16:27

## Summary

**CAD Number** F2481140 **Status** Closed  
**Station** Grey Lynn Station  
**Incident Started** 14/02/2018 08:12:06 **Incident Ended** 14/02/2018 08:33:51  
**Incident Type** 7104: False Alarm: Accidental Operation K-46-2  
**Common Name** BIRKENHEAD COLLEGE BLOCK S AND LIBRARY  
**Address** MA1 / 140 Birkdale Road Birkdale  
**Alarm Method** Manual PFA Call **Alarm Level** 1  
**PFA Number** 101024  
**Zone** 148207  
**Map Grid E** 1751632 **Map Grid N** 5925988  
**First Caller** **First Caller Contact**  
**Incident Closed** 14/02/2018 08:50:02  
**Report Completed** 9:51, Fri 23 Feb 2018 by Mark Shaw

## Responses

Call Sign	Type	Station Alert	Enroute Time	Arrival Time	Departed
GREY261	P1	08:12:42 14 Feb 2018	08:13:46 14 Feb 2018	08:23:05 14 Feb 2018	08:33:53 14 Feb 2018
AUCK207	PR	08:12:43 14 Feb 2018	08:14:03 14 Feb 2018	08:27:06 14 Feb 2018	08:27:46 14 Feb 2018

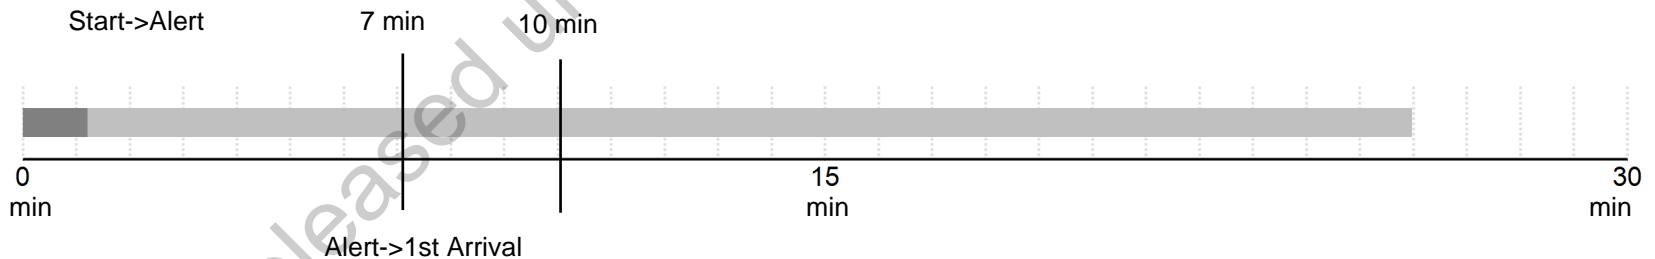

## Elapsed Times

Call Sign	Start To Alert	Alert To Arrival	Start To Arrival	Start To Departed
GREY261	00:00:36	00:10:23	00:10:59	00:21:47
AUCK207	00:00:37	00:14:23	00:15:00	00:15:40

**Notifications**

Date	Time	Party Notified
14 Feb 2018	08:14:04	SELCAL FAILURE ON GREY261 (K3-1480). ADHOC SELCAL APPLIED = SUCCEEDED

**Message Log**

Time	Message
08:12:08	AL: 101024 08:12:06 INITIAL - AL
08:12:08	PANEL: INSIDE SERVER ROOM OF ADMIN BUILDING
08:12:10	** LOI search completed at 14/02/18 08:12:10
08:12:17	** Recommended unit GREY261 for requirement PUMP (>4.8 km)
08:12:17	** Recommended unit AUCK207 for requirement PUMP (>8.2 km)
08:12:26	ACCESS NO: -82-26
08:13:47	Unit GREY261 [ K1 : PROCEEDING TO INCIDENT]
08:14:04	Unit AUCK207 [ K1 : PROCEEDING TO INCIDENT]
08:23:06	Unit GREY261 [ K77 : NOTHING SHOWING]
08:23:15	Unit GREY261 [ K77 : NOTHING SHOWING]
08:26:25	Unit GREY261 [ KC : UNIT CALLING]
08:26:52	Unit GREY261 [ SITREP : ] SO SHAW - PANEL SHOWING FIRE - ZONE THREE - BLOCK S -
08:26:52	INVESTIGATING FURTHER
08:27:07	Unit AUCK207 [ K2 : IN ATTENDANCE AT INCIDENT]
08:27:47	Unit AUCK207 [ K3 : ON RT OUTSIDE NORMAL TURNOUT AREA]
08:33:12	Unit GREY261 [ KC : UNIT CALLING]
08:33:51	Unit GREY261 [ K46-2 : STOP MESSAGE: FALSE ALARM ACCIDENTAL] DEODORANT SPRAY
08:33:54	Unit GREY261 [ K3 : ON RT OUTSIDE NORMAL TURNOUT AREA]
08:50:02	** Assigned Result Code: STRU, Detailed Event Type: 7100, Qualifier 1: Q1,
08:50:02	Qualifier 2:

**Incident**

CAD Number F2481140  
 Incident Reporter Mark Shaw  
 Incident Controller  
 Distance Travelled (km)  
 Delay In Receiving Call

**False Alarm**

Detector Type Smoke detector  
 False Alarm Cause Human Intervention | Steam or dust mistaken for smoke

**Other Cause** Deodorant spray under detector head.

**Property Details**

---

**Occupant**

**Building Owner**

**General Property Use** School: Pre-school through to Secondary/High

**Special Property Use** High school, College

**Purpose Group**

**Civilians**

---

**Civilians Rescued** 0

**Civilians Extricated** 0

**Civilians Assisted** 0

**Civilians Evacuated** 0

**Comments**

2/23/2018 9:51:38 AM

**Reporter Comments**

---

Deodorant spray under detector head.

**Mark Shaw**