

SMS Incident Report


11/08/2017 08:58:18

Summary

CAD Number F2355307 **Status** Closed
Station Auckland City Station
Incident Started 02/08/2017 11:22:25 **Incident Ended** 02/08/2017 11:33:20
Incident Type 7105: False alarm: Excess Smoke, Heat
Common Name TWENTY SIX PUTIKI STREET
Address 26 PUTIKI STREET GREY LYNN
Alarm Method 111 Telephone **Alarm Level** 1
PFA Number
Zone 142624
Map Grid E 1755969 **Map Grid N** 5918879
First Caller **First Caller Contact** ██████████
Incident Closed 02/08/2017 11:42:22
Report Completed 13:53, Wed 02 Aug 2017 by Kenton Rusbridge

Responses

Call Sign	Type	Station Alert	Enroute Time	Arrival Time	Departed
AUCK207	PR	11:23:34 02 Aug 2017	11:24:42 02 Aug 2017	11:27:20 02 Aug 2017	11:34:33 02 Aug 2017
BALM611	P1	11:23:37 02 Aug 2017	11:26:00 02 Aug 2017	11:30:18 02 Aug 2017	11:31:28 02 Aug 2017

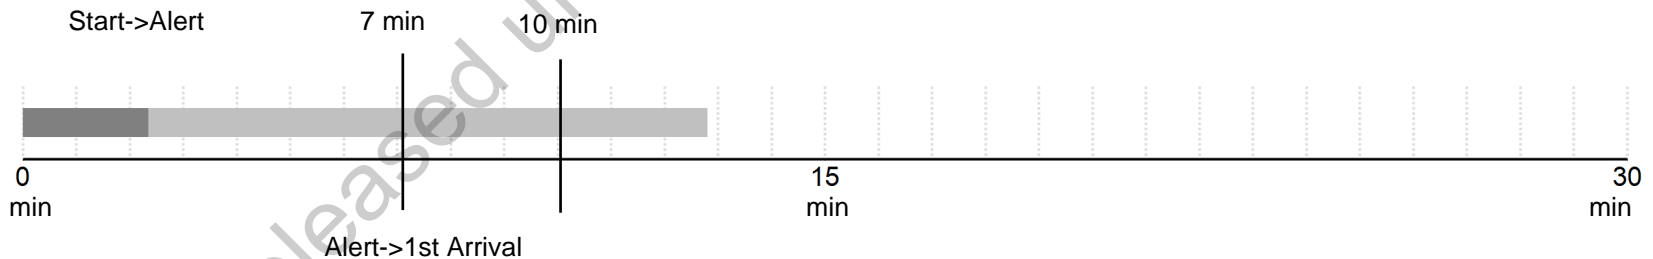

Elapsed Times

Call Sign	Start To Alert	Alert To Arrival	Start To Arrival	Start To Departed
AUCK207	00:01:09	00:03:46	00:04:55	00:12:08
BALM611	00:01:12	00:06:41	00:07:53	00:09:03

Message Log

Time	Message
11:23:15	INC INFO: FIRE ALARM SOUNDING @ COURIOUS FILM
11:23:16	** LOI search completed at 02/08/17 11:23:16
11:23:24	** Recommended unit AUCK207 for requirement PUMP (>1.1 km)
11:23:24	** Recommended unit BALM611 for requirement PUMP (>2.6 km)
11:23:43	CALLER DID STATE THAT THIS WAS CAUSED BY BURNT TOAST
11:23:57	INC INFO: FIRE ALARM SOUNDING @ CURIOUS FILM
11:24:42	Unit AUCK207 [K1 : PROCEEDING TO INCIDENT]
11:26:00	Unit BALM611 [K1 : PROCEEDING TO INCIDENT]
11:27:21	Unit AUCK207 [K77 : NOTHING SHOWING]
11:29:29	Unit AUCK207 [KC : UNIT CALLING]
11:29:34	Unit AUCK207 [KC : UNIT CALLING]
11:30:18	Unit BALM611 [K2 : IN ATTENDANCE AT INCIDENT]
11:30:40	Unit AUCK207 [SITREP :] SSSO RUSBRIDGE IPS FIRE ZONE 1 1ST FLOOR REPORTS OF
11:30:40	BURNT TOAST K2801
11:31:29	Unit BALM611 [K3 : ON RT OUTSIDE NORMAL TURNOUT AREA]
11:33:01	Unit AUCK207 [KC : UNIT CALLING]
11:33:01	Unit AUCK207 [K28-1 : RETURN OTHER RESPONDING UNITS]
11:33:21	Unit AUCK207 [K46-2 : STOP MESSAGE: FALSE ALARM ACCIDENTAL] TOAST
11:34:34	Unit AUCK207 [K4 : ON RT INSIDE NORMAL TURNOUT AREA]
11:42:22	** Assigned Result Code: STRU, Detailed Event Type: 7100, Qualifier 1: Q1,
11:42:22	Qualifier 2:

Incident

CAD Number F2355307
Incident Reporter Kenton Rusbridge
Incident Controller rusbridge
Distance Travelled (km)
Delay In Receiving Call

False Alarm

Detector Type Smoke detector
False Alarm Cause Building Usage | Fumes from toasters
Other Cause

Property Details

Occupant
Building Owner

General Property Use	Office, Bank, Embassy, Fire/Ambulance/Police station
Special Property Use	Office: General business
Purpose Group	WL - Working, Business or Storage Light Fire Hazard

Comments

8/2/2017 1:52:42 PM

Reporter Comments

storage room next door to kitchen room

Kenton Rusbridge

Released under the Official Information Act